

# DESIGN AND SIMULATION OF GRID-CONNECTED PV SYSTEMS WITH GENERATION OF CONSTANT POWER USING FUZZY LOGIC CONTROLLER

<sup>1</sup>G.SUDHEER, <sup>2</sup>G.HARIBABU

<sup>1</sup>M.Tech, NOVA INSTITUTE OF ENGINEERING AND TECHNOLOGY, VEGAVARAM,JANGAREDDYGUDEM

<sup>2</sup>ASSISTANT PROFESSOR, NOVA INSTITUTE OF ENGINEERING AND TECHNOLOGY, VEGAVARAM,JANGAREDDYGUDEM

**ABSTRACT :**In this paper an improved control strategy is implemented the incremental method of the maximum power which is feed to the PV systems and it is proposed to make sure about the smooth and fast transition between Constant Power Generation (CPG) and maximum power point tracking, and also by the proposed Fuzzy logic control strategy we can always achieved the stable operation, Regardless of the solar irradiance levels and high-performance. Fuzzy logic is an approach to computing based on "degrees of truth" rather than the usual "true or false" (1 or 0) Boolean logic on which the modern computer is based. Which can be regulate by the PV output power according to any set-point, and it also force the PV systems to operate at the left side of the maximum power point without any stability problems. Simulation results have been verified in the effectiveness manner by using the proposed CPG control in terms of high accuracy, stable transitions, and fast dynamics.

**Index Terms**—Active power control, constant power control, maximum power point tracking, PV systems, power converters fuzzy logic controller.

## INTRODUCTION

In the recent year, Maximum Power Point Tracking (MPPT) operation is necessary in the grid-connected PV systems in order to get the maximize power from the energy yield. PV installations is need for the advance power control schemes and along with the regulations to decrease impacts from PV systems such as the overloading the power grid . For the German Federal Law: Renewable Energy Sources Act in which the PV systems with the rated power below 30kWp which have the  $P_{limit}$  for the maximum which is feed to the power (e.g. 70 % of the rated power) which can be remotely controlled by the utility like the active power control which is referred as the Constant Power Generation (CPG) control or an absolute power control which is described in the Danish grid code in which CPG concept which have been presented which is reveals by the most cost-effective way to achieve the CPG control is by modifying the MPPT algorithm at the PV inverter level. Specifically, the PV system is operated in the MPPT mode, when the PV output power  $P_{pv}$  is below the setting-point  $P_{limit}$ .

$$P_{PV} = \begin{cases} P_{MPPT}, & \text{when } P_{PV} \leq P_{limit} \\ P_{limit}, & \text{when } P_{PV} > P_{limit} \end{cases} \quad (1)$$

Moreover, whenever the output power reach the  $P_{limit}$ , then the output power of the PV system will be kept constant, i.e.,  $P_{pv} = P_{limit}$ , which leading to the constant active power which is injected as shown in (1) and it also illustrated in Fig. 1 In terms of the algorithms and the CPG which is based upon the Perturb and Observe (P&O-CPG) algorithm which was introduced by the single stage PV systems. Moreover during the operating area of the CPG control this is limited at the right side of the Maximum Power Point (MPP) of the PV arrays (CPP-R), due to its single-stage configuration. Unfortunately it will reduce the robustness of the control algorithm when the PV systems is experience with the fast decrease during the irradiance time .

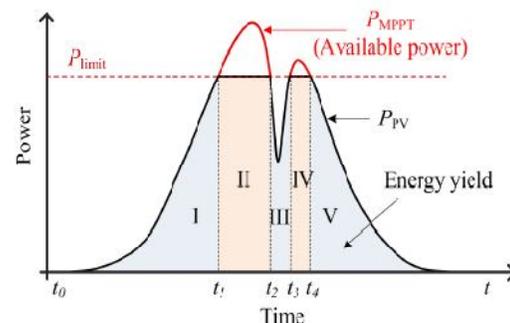


Fig.1. Constant Power Generation (CPG) concept: 1) MPPT mode during I, III, V, and 2) CPG mode during II, IV [6].

The operating point may go through the open-circuit condition which is illustrated and shown in the Fig.2. A two-stage grid-connected PV is implemented to extend the operating area of the P&O-CPG algorithm. And also by regulating the PV output power which at the left side of the MPP (CPP-L) as shown in Fig. 2, where the stable CPG operation is always achieved by the operating point which will never “fall off the hill” during a fast reduce in the irradiance.

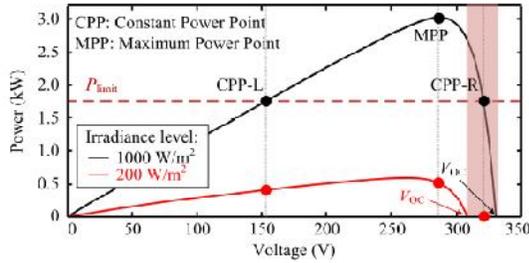


Fig.2. Stability issues of the conventional CPG algorithms, when the operating point is normally located at the right side of the MPP.

Both the P&O-CPG algorithm can be applied to any two-stage single-phase PV system.

**CONVENTIONAL CPG ALGORITHM**

**System Configuration**

As shown in the Fig. 3 shows the basic hardware configuration of the two-stage single-phase grid-connected PV system and its control structure. The CPG control is developed in the boost converter, which has been explained in the next section.

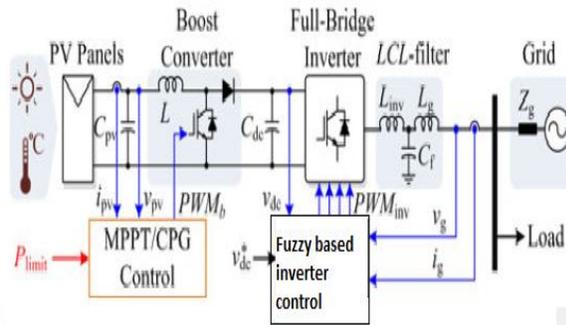


Fig. 3. Simulation of schematic and overall control structure of a two-stage single-phase grid-connected PV system

The full-bridge inverter control is realized by the cascaded control; here the DC-link voltage is kept constant throughout the control of the AC grid current, which is an inner loop. An active power is injected to the grid, which meaning that the PV system operates at a unity power factor. Not only that have been mentioned above and the two-stage configuration can extend the operating range of both the MPPT and CPG algorithms. In the two-stage case, the PV output voltage  $v_{pv}$  can be lower (e.g., at the left side of the MPP), and then it can be stepped up by the boost converter to match the required DC-link voltage (e.g., 450 V) [10]. This is not the case for the single-stage configuration, where the PV output voltage  $v_{pv}$  is directly fed to the PV inverter and has to be higher than the grid voltage level (e.g., 325 V) to ensure the power delivery .

**Operational Principle**

The operational principle of the conventional P&O-CPG algorithm is illustrated in Fig. 4. It can be divided into two modes: a) MPPT mode ( $P_{pv} < P_{limit}$  comparing alternative power generation technologies, the most important measure is the energy cost per kilowatt hour delivered. In PV power, this cost primarily depends on two parameters: the PV energy conversion efficiency and the capital cost per watt capacity. Together, these two parameters indicate the economic competitiveness of the PV electricity), where the P&O algorithm should track the maximum power; b) CPG mode ( $P_{pv} > P_{limit}$ ), where the PV output power is limited at  $P_{limit}$ . During the MPPT operation, the behavior of the algorithm is similar to the conventional P&O MPPT algorithm - the operating point will track and oscillate around the MPP [.

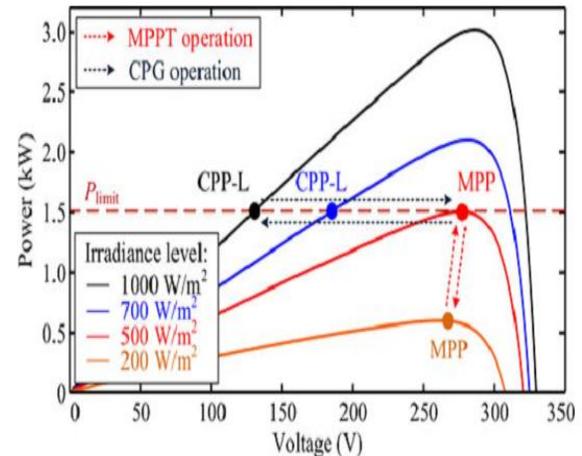


Fig.4. Operational principle of the Perturb and Observe based CPG algorithm (P&O-CPG), where the operating point is regulated to the left side of the MPP considering stability issues.

In the case of the CPG operation, the PV voltage  $v_{pv}$  is continuously perturbed toward a point referred to as Constant Power Point (CPP), i.e.,  $P_{pv} = P_{limit}$ . After a number of iterations, the operating point will reach and oscillate around the CPP. Although the PV system with the P&O-CPG control can operate at both CPPs, only the operation at the left side of the MPP (CPP-L) is focused for the stability concern. The control structure of the algorithm is shown in Fig. 5, where  $v_{pv}^*$  can be expressed as

$$v_{pv}^* = \begin{cases} v_{MPPT}, & \text{when } P_{pv} \leq P_{limit} \\ v_{pv,n} - v_{step}, & \text{when } P_{pv} > P_{limit} \end{cases} \quad (2)$$

Where  $v_{MPPT}$  is the reference voltage from the MPPT algorithm (i.e., the P&O MPPT algorithm),  $v_{pv,n}$  is the measured PV voltage, and  $v_{step}$  is the perturbation step size.

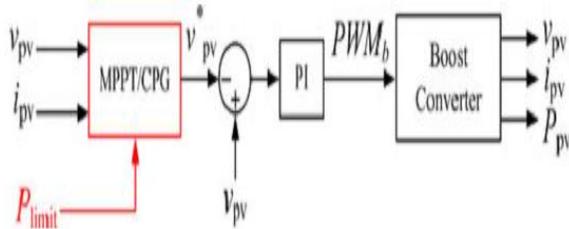


Fig.5. Control structure of the Perturb and Observe based CPG algorithm (P&O-CPG), where a Proportional Integrator (PI) is adopted.

**Issues of the P&O-CPG Algorithm**

The P&O-CPG algorithm has a satisfied performance under slow changing irradiance conditions, e.g., during a clear day, when the operating point is at the left side of the MPP, as shown in Fig. 6(a). However, irradiance fluctuation that may happen in a cloudy day will result in overshoots and power losses as shown in Fig. 6(b).

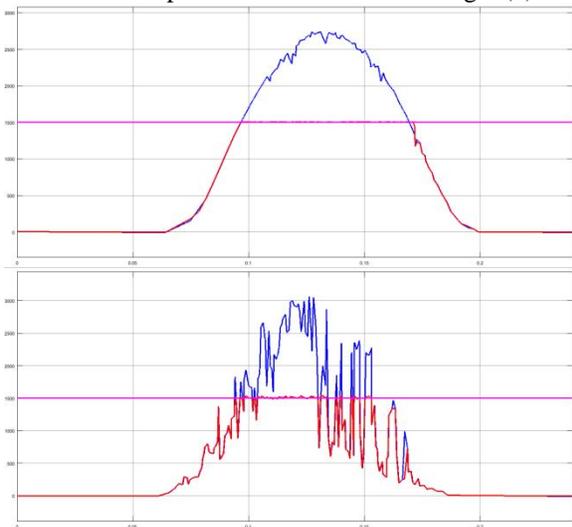


Fig.6. Simulation results of the Perturb and Observe based CPG algorithm (P&O-CPG) under two daily conditions: (a) clear day and (b) cloudy day.

This can be further explained using the operation trajectory of the PV system presented in Fig. Assuming that the PV system is operating in MPPT mode initially and the irradiance level suddenly increases, the PV power  $P_{pv}$  is basically lifted by the change in the irradiance, as it can be seen from the black arrow trajectory (i.e., A!B!C). As a consequence, large power overshoots may occur. Similarly, if the PV system is operating in the CPG operation (e.g., at CPP-L) and the irradiance suddenly drops, the output power  $P_{pv}$  will make a sudden decrease, as shown in Fig. (i.e.,CID). It will take a number of iterations until the operating point reaches the new MPP (i.e., E) at that irradiance condition (i.e., 200 W/m<sup>2</sup>), and resulting in loss of power generation.

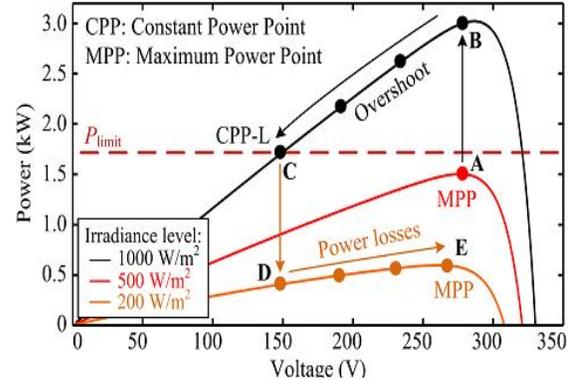


Fig.7. Operating trajectory of the algorithm during a fast changing irradiance condition resulting in overshoot (black arrow) and power losses (orange arrow).

**HIGH-PERFORMANCE P&O-CPG ALGORITHM**

According to the above, two main tasks exist - minimizing the overshoots and minimizing the power losses during the fast changing irradiance condition which has to be addressed in the case of CPG operation. The proposed high-performance P&O-CPG algorithm can effectively solve those issues. A. Minimizing Overshoots Increasing the perturbation step size is a possibility to minimize the overshoots as the tracking speed is increased. Specifically, a large step size can reduce the required number of iterations to reach the corresponding CPP. Notably, the step size modification should be enabled only when the algorithm detects a fast increase in the Irradiance Condition (IC), which can be illustrated as

$$IC = \begin{cases} 1, & \text{when } P_{pv,n} - P_{limit} > \epsilon_{inc} \\ 0, & \text{when } P_{pv,n} - P_{limit} \leq \epsilon_{inc} \end{cases} \quad (3)$$

With  $P_{pv,n}$  being the measured PV power at the present sampling, and "inc being the criterion, which should be larger than the steady-state power oscillation of the PV panels. When a fast increase in the IC is detected (i.e., IC = 1), an adaptive step size is then employed, where the step size is calculated based on the difference between  $P_{limit}$  and  $P_{pv,n}$  as it is given in (4). By doing so, the large step size will be used initially and the step size will continuously be reduced as the operating point approaches to the CPP.

$$v^*_{pv} = v_{pv,n} - \left[ (P_{pv,n} - P_{limit}) \frac{P_{limit}}{P_{mp,\gamma}} \right] \cdot v_{step} \quad (4)$$

Where  $v_{pv}$  is the reference output voltage of the PV arrays,  $v_{pv,n}$  and  $P_{pv,n}$  are the measured output voltage and power of the PV array at the present sampling, respectively.  $P_{mp}$  is the rated power.  $v_{step}$  is the original step size of the P&O-CPG algorithm. The term  $P_{limit}=P_{mp}$  is introduced to alleviate the step size dependency in the level of  $P_{limit}$ . is a constant which can be used to tune the speed of the algorithm.

### Minimizing Power Losses

As explained in Fig. when the CPG operating point is at the left side of the MPP, the P&O-CPG algorithm requires a number of iterations to reach the new MPP during a fast decrease in irradiance, leading to power losses. In fact, the operating point of the PV system does not change much if the PV system is operating in the MPPT under different irradiance levels as shown in Fig. 8. Notably, the detection of the decreased IC as well as the Previous Operating Mode (POM) is also important for minimizing the power losses:

$$IC = \begin{cases} 1, & \text{when } P_{PV,n-1} - P_{PV,n} > \epsilon_{dec} \\ 0, & \text{when } P_{PV,n-1} - P_{PV,n} \leq \epsilon_{dec} \end{cases} \quad (5)$$

$$POM = \begin{cases} \text{CPG}, & \text{when } |P_{limit} - P_{PV,n-1}| > \epsilon_{ss} \\ \text{MPPT}, & \text{when } |P_{limit} - P_{PV,n-1}| \leq \epsilon_{ss} \end{cases} \quad (6)$$

Where "dec" and "ss" are criteria to determine the fast irradiance decrease and the CPG operating mode, respectively.  $P_{pv,n-1}$  is the measured PV power at the previous sampling. For example, the value of "ss" can be chosen as 1-2 % of the rated power of the PV system, which is normally higher than the steady-state error in the PV power of the P&O-CPG algorithm. When a fast decrease (i.e.,  $IC = 1$ ) is detected during the CPG to MPPT transition according to (6), a constant voltage given by (7) is applied to the PV system in order to accelerate the tracking speed (i.e., minimize the power losses). The constant voltage can be approximated as 71-78 % of the open circuit voltage  $V_{OC}$ , as illustrated in Fig. 7 .

$$v_{pv}^* = k \cdot V_{OC}, \text{ where } 0.71 \leq k < 0.78 \quad (7)$$

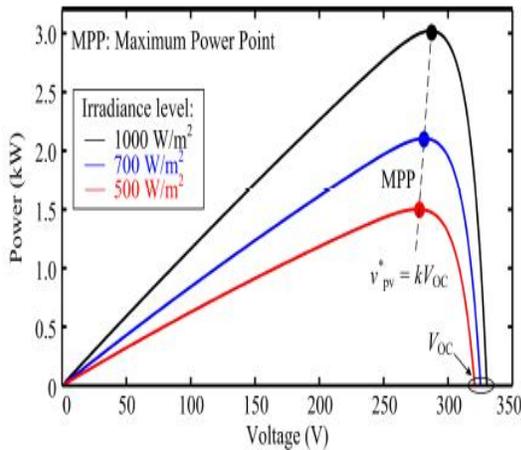


Fig. 8. Power-voltage (P-V) curves of the PV arrays, where the voltage at the MPP is almost constant especially at a higher irradiance level.

By doing so, the operating point can be instantaneously moved close to the MPP in one perturbation, resulting in a significant reduction in the number of iterations until the operating point reaches the MPP. This approach is simple but effective, which is very suitable to be implemented.

### FUZZY CONTROL SYSTEM

A fuzzy control system consists of the following components:

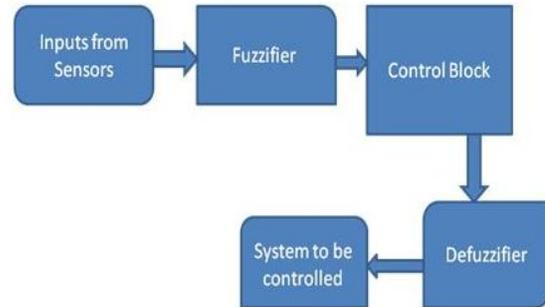


Fig 9 Fuzzy Logic Controller

#### Control Block

A Controller which performs the fuzzy logic operation of assigning the outputs based on the linguistic information. It performs approximate reasoning based on human way of interpretation to achieve the control logic. The controller consists of the knowledge base and the inference engine. The knowledge base consists of the membership functions and the fuzzy rules, which are obtained by knowledge of the system operation according to the environment.

#### Defuzzifier

The Defuzzifier converts this fuzzy output to the required output to control the system.

#### SIMULATION VERIFICATION

Solutions to improve the dynamic performance of the P&OCPG algorithm have been discussed above. Parameters of the proposed high-performance P&O-CPG algorithm are designed as:  $\epsilon_{dec} = 10$ ,  $k = 0.715$ , "inc" = 50 W, "dec" = 100 W, and "ss" = 30 W. Simulation are carried out referring to Fig. 3, and the system parameters are given in Table I.

Table I  
Parameters of The Two-Stage Single-Phase Pv System

Boost converter inductor	$L_c = 1.8 \text{ mH}$
PV-side capacitor	$C_{pv} = 1000 \mu\text{F}$
DC-link capacitor	$C_{dc} = 1100 \mu\text{F}$
LCL-filter	$L_{inv} = 4.8 \text{ mH}$ , $L_g = 4 \text{ mH}$ , $C_f = 4.3 \mu\text{F}$
Switching frequency	Boost converter: $f_s = 16 \text{ kHz}$ , Full-Bridge inverter: $f_{inv} = 8 \text{ kHz}$
DC-link voltage	$V_{dc} = 450 \text{ V}$
Grid nominal voltage (RMS)	$V_g = 230 \text{ V}$
Grid nominal frequency	$\omega_0 = 2\pi \times 50 \text{ rad/s}$

In the simulation, a 3-kW PV simulator has been adopted, where real-field solar irradiance and ambient temperature profiles are programmed. Fig. 10 shows the performance of the proposed high performance P&O-CPG method with two real-field daily conditions. In contrast to the conventional

P&O-CPG method (shown in Fig. 6), the overshoots and power losses are significantly reduced by the proposed solution and a stable operation. is also maintained. The algorithm also has a selective behavior to only react, when the fast irradiance condition is detected. This can be seen from the performance under clear irradiance conditions in Fig. 10(a), which is similar to the conventional P&O-CPG algorithm (shown in Fig. 6(a)).

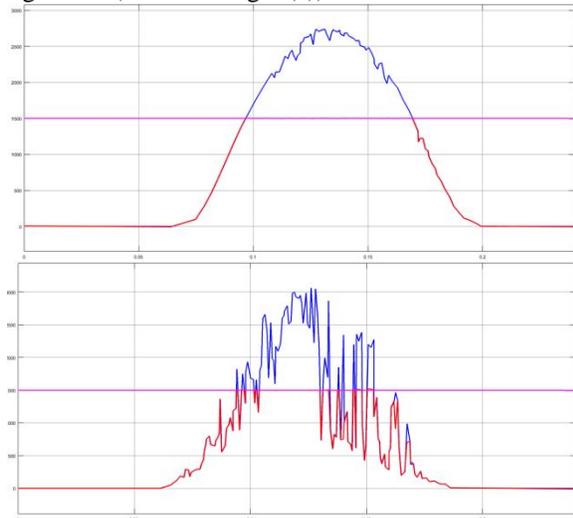


Fig.10. Simulation Results Of The Proposed High-Performance P&O-CPG Algorithm Under Two Daily Conditions: (A) Clear Day And (B) Cloudy Day.

### CONCLUSION

In this paper observed that an high-performance active power control scheme been limiting the maximum power which is feed to the PV systems which is proposed there. The proposed solution makes sure about the stable constant power generation operation. When compared with the traditional methods. Here the proposed fuzzy logic control strategy will forces the PV systems to operate at the left side of the maximum power point, and which make to achieve a stable operation along with smooth transitions. Simulation has verified the effectiveness of the proposed control solution in order to minimized power losses, reduced overshoots and also fast dynamics. Moreover for single-stage PV systems, same concept of CPG is also applicable. Therefore in such case, the PV voltage operating range will limited and some small changes in the algorithms which are necessary to make sure for a stable operation.

### REFERENCES

- [1] T. Stetz, F. Marten, and M. Braun, "Improved low voltage grid integration of photovoltaic systems in Germany," *IEEE Trans. Sustain. Energy*, vol. 4, no. 2, pp. 534–542, Apr. 2013.
- [2] A. Ahmed, L. Ran, S. Moon, and J.-H. Park, "A fast PV power tracking control algorithm with

reduced power mode," *IEEE Trans. Energy Conversion*, vol. 28, no. 3, pp. 565–575, Sept. 2013.

- [3] Y. Yang, H. Wang, F. Blaabjerg, and T. Kerekes, "A hybrid power control concept for PV inverters with reduced thermal loading," *IEEE Trans. Power Electron.*, vol. 29, no. 12, pp. 6271–6275, Dec. 2014.
- [4] German Federal Law: Renewable Energy Sources Act (Gesetz für den Vorrang Erneuerbarer Energien) BGBl. Std., July 2014.
- [5] Energinet.dk, "Technical regulation 3.2.5 for wind power plants with a power output greater than 11 kw," Tech. Rep., 2010.
- [6] Y. Yang, F. Blaabjerg, and H. Wang, "Constant power generation of photovoltaic systems considering the distributed grid capacity," in *Proc. of APEC*, pp. 379–385, Mar. 2014.
- [7] R. G. Wandhare and V. Agarwal, "Precise active and reactive power control of the PV-DGS integrated with weak grid to increase PV penetration," in *Proc. of PVSC*, pp. 3150–3155, Jun. 2014.
- [8] W. Cao, Y. Ma, J. Wang, L. Yang, J. Wang, F. Wang, and L. M. Tolbert, "Two-stage PV inverter system emulator in converter based power grid emulation system," in *Proc. of ECCE*, pp. 4518–4525, Sept. 2013.
- [9] A. Urtasun, P. Sanchis, and L. Marroyo, "Limiting the power generated by a photovoltaic system," in *Proc. of SSD*, pp. 1–6, Mar. 2013.
- [10] S. B. Kjaer, J. K. Pedersen, and F. Blaabjerg, "A review of single-phase grid-connected inverters for photovoltaic modules," *IEEE Trans. Ind. Appl.*, vol. 41, no. 5, pp. 1292–1306, Sept. 2005.